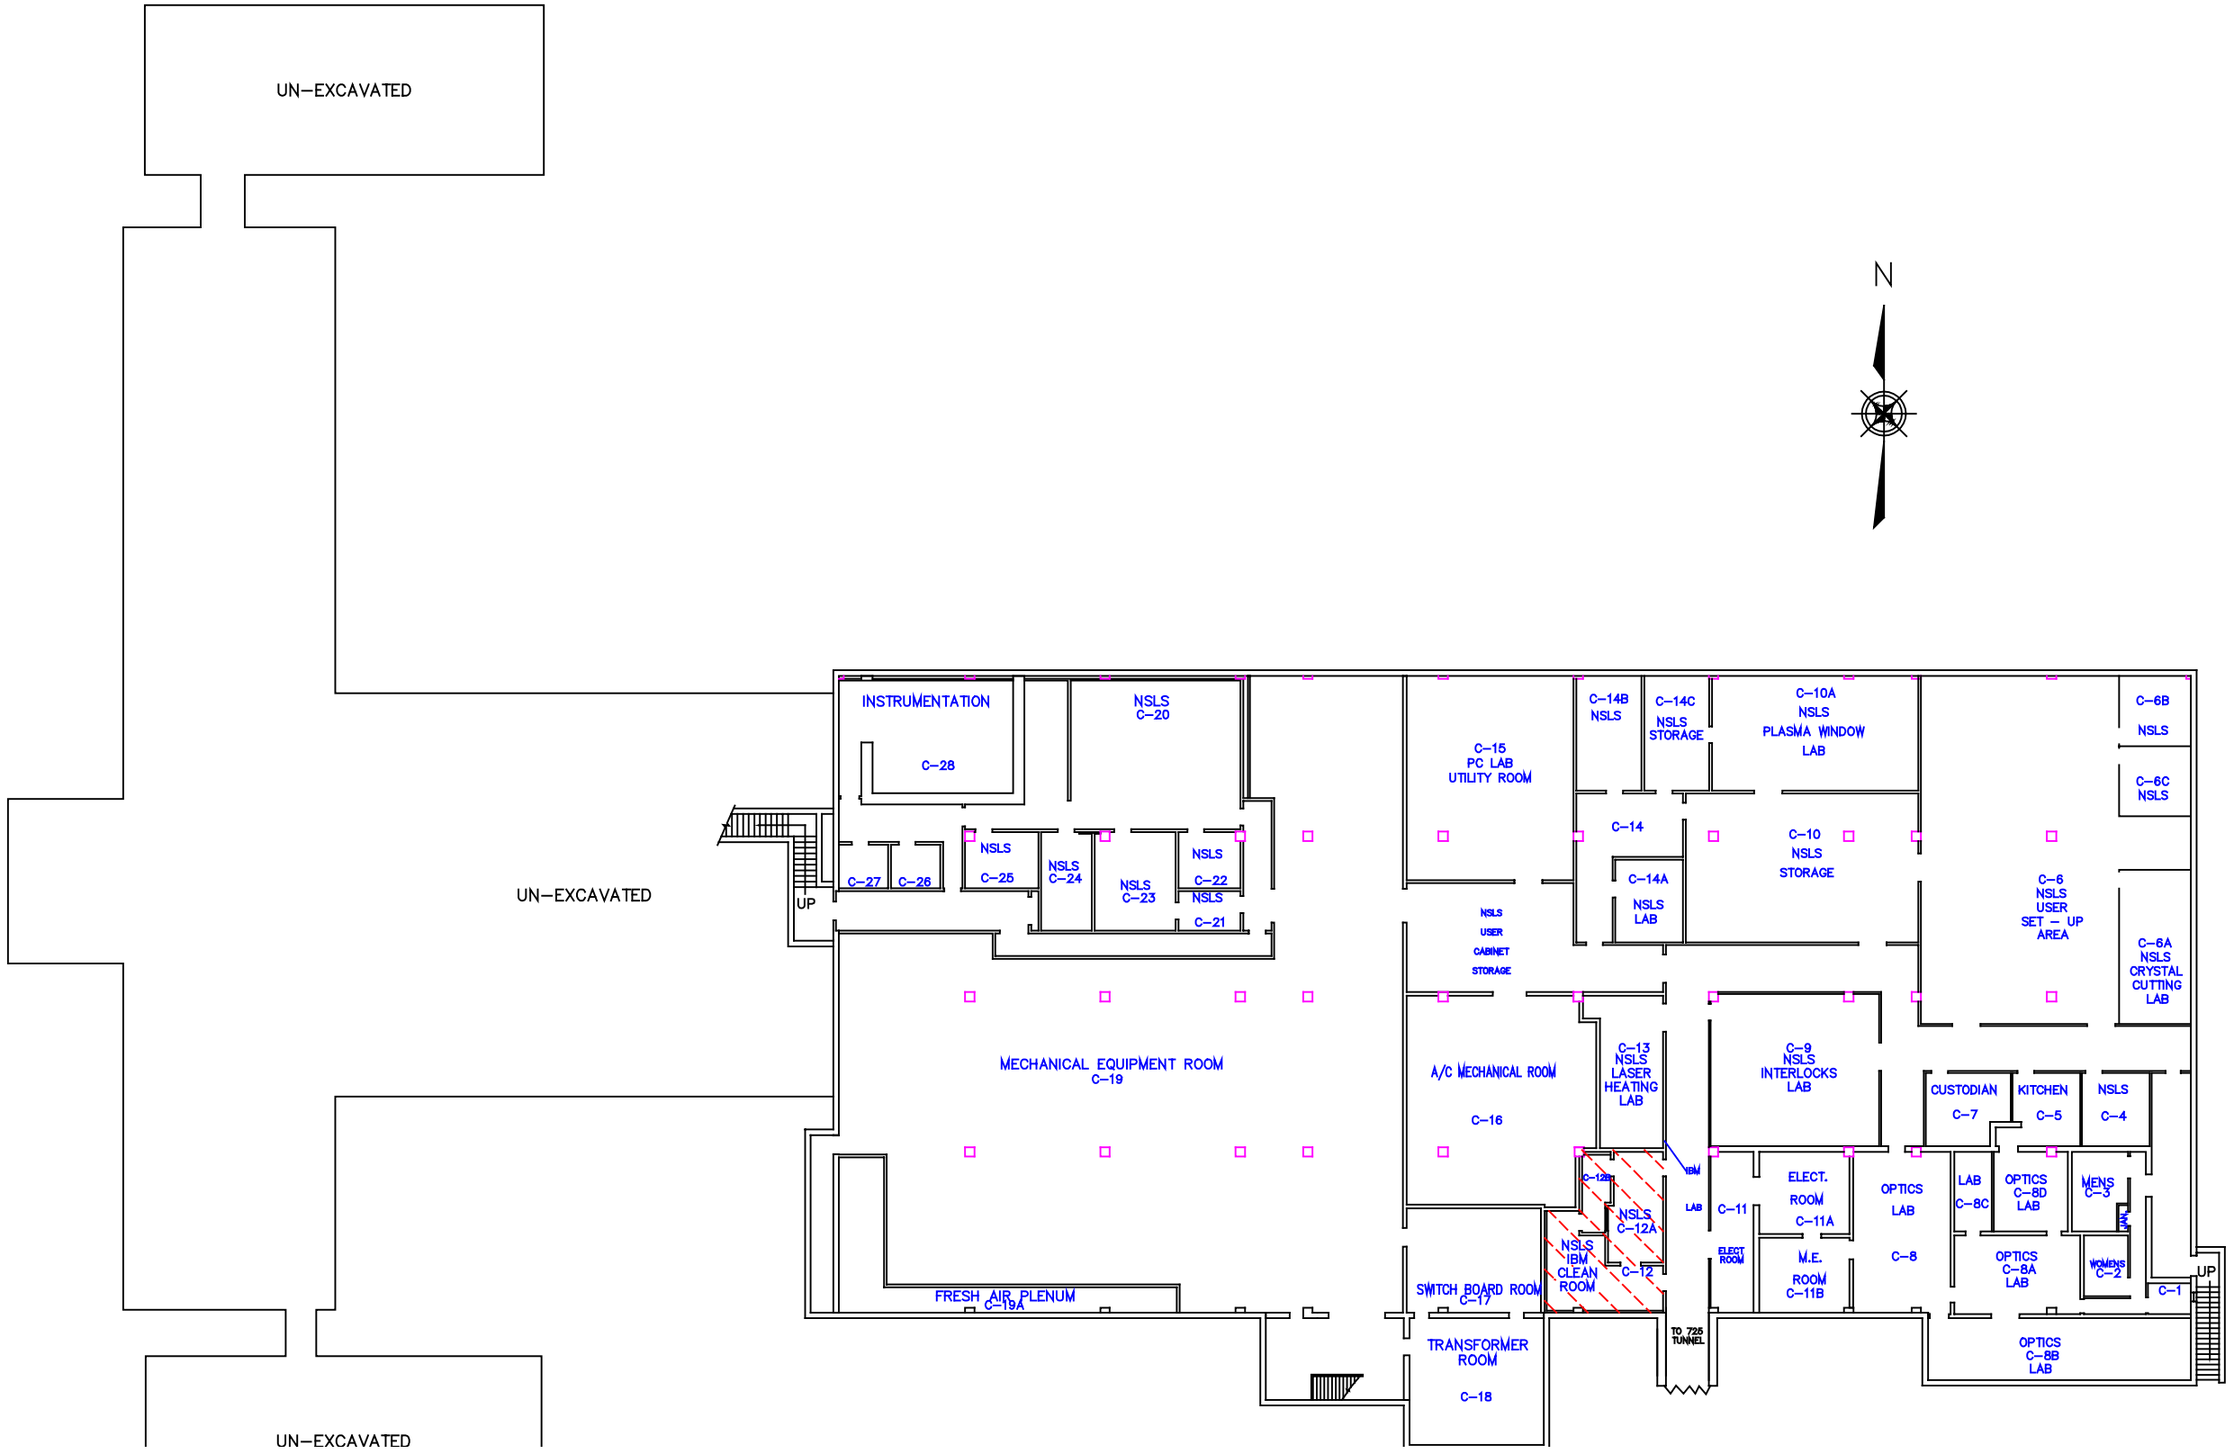
UN–EXCAVATED
N
INSTRUMENTATION
C–28
NSLS
C–20
C–27
C–26
NSLS
C–25
NSLS
C–24
NSLS
C–23
NSLS
C–22
NSLS
C–21
UP
UN–EXCAVATED
MECHANICAL EQUIPMENT ROOM
C–19
FRESH AIR PLENUM
C–19A
C–15
PC LAB
UTILITY ROOM
NSLS
USER
CABINET
STORAGE
A/C MECHANICAL ROOM
C–16
SWITCH BOARD ROOM
C–17
TRANSFORMER
ROOM
C–18
C–14B
NSLS
C–14C
NSLS
STORAGE
C–14
C–14A
NSLS
LAB
C–10A
NSLS
PLASMA WINDOW
LAB
C–10
NSLS
STORAGE
C–6B
NSLS
C–6C
NSLS
C–6
NSLS
USER
SET – UP
AREA
C–6A
NSLS
CRYSTAL
CUTTING
LAB
C–13
NSLS
LASER
HEATING
LAB
C–9
NSLS
INTERLOCKS
LAB
CUSTODIAN
C–7
KITCHEN
C–5
NSLS
C–4
C–12B
NSLS
C–12A
NSLS
IBM
CLEAN
ROOM
C–12
IBM
LAB
C–11
ELECT
ROOM
ELECT.
ROOM
C–11A
M.E.
ROOM
C–11B
OPTICS
LAB
C–8
LAB
C–8C
OPTICS
C–8D
LAB
MENS
C–3
WOMENS
C–2
OPTICS
C–8A
LAB
C–1
UP
OPTICS
C–8B
LAB
TO 725
TUNNEL
UN–EXCAVATED